





Model 1200 REMOTE TEST®

Remote Operated TEST_{AN}DRAIN® Valve

Remote System Inspection with Fail Safe Integrity

How the REMOTE TEST® Works: Energizing the solenoid allows system water to flow through a test orifice. After the preset time delay, the water flow alarm is activated, confirming system integrity. No response from the system alarms indicates potential system problems, such as: No water flowing in the system, an operable water flow alarm, or other system problems that may require site investigation. The REMOTE TEST® is designed to be integrated into an existing panel or wired to an independent panel allowing ONE PERSON to activate each specific system or group of systems from one central location.

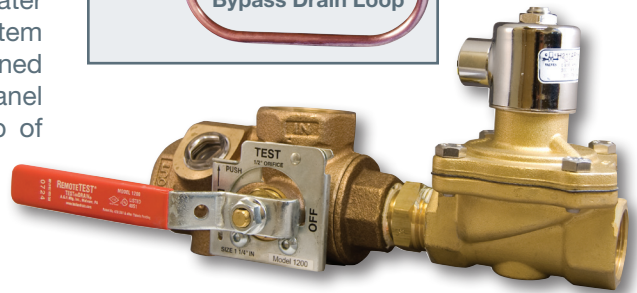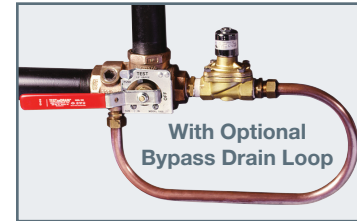


- Allows system tests to be performed easily during off-peak hours
- Ability to test each floor individually is unaffected
- Available in 24V DC or 120V AC
- Wiring does not require a supervised circuit
- Complies with NFPA 13, 2007 Edition, Chapters 8.16.2.4.1 - 8.16.2.4.4, A.8.17.4.2, 8.17.4.2.2, 8.17.4.2.4, 8.17.4.3.1, and 8.17.3.2
- Repair Kits available


Sizes:

3/4"	1"	1 1/4"	1 1/2"	2"
------	----	--------	--------	----


Model 1200 - Plan View

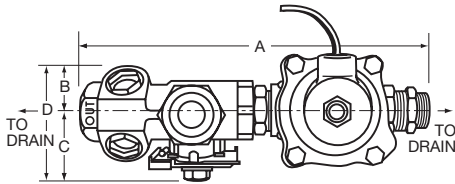

Model 1200 - Front View

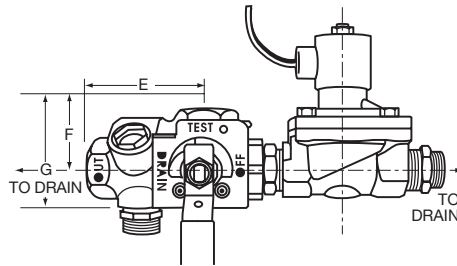

With Optional Bypass Drain

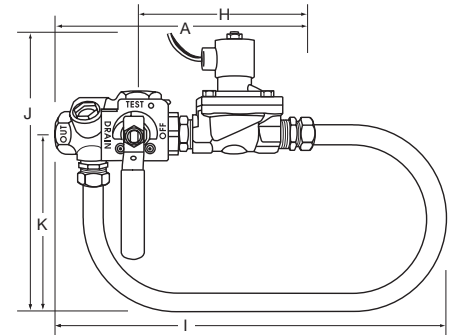

Dimensions

Orifice Size Available: 3/8", 7/16", 1/2", 17/32", ELO (5/8"), ESFR (3/4")*, K25**

SIZE	A	B	C	D	E	F	G	H	I†	J†	K†
1"	9 1/2" (241 mm)	1 3/4" (45 mm)	2 1/4" (57 mm)	4" (102 mm)	3 1/4" (83 mm)	1 3/4" (45 mm)	6 1/2" (165 mm)	6 1/4" (159 mm)	18 1/2" (470 mm)	12 3/4" (324 mm)	8 3/4" (222 mm)
1 1/4"	10" (254 mm)	1 3/4" (45 mm)	3" (72 mm)	4 3/4" (121 mm)	3 1/4" (83 mm)	1 3/4" (45 mm)	7 1/4" (184 mm)	6 1/2" (165 mm)	18 1/2" (470 mm)	12 3/4" (324 mm)	8 3/4" (222 mm)
1 1/2"	11" (279 mm)	1 3/4" (45 mm)	3 3/4" (95 mm)	5 1/2" (140 mm)	4" (102 mm)	2 3/4" (70 mm)	11" (279 mm)	7 1/4" (184 mm)	18 1/2" (470 mm)	12 3/4" (324 mm)	8 3/4" (222 mm)
2"	11" (279 mm)	1 3/4" (45 mm)	3 3/4" (95 mm)	5 1/2" (140 mm)	4" (102 mm)	2 3/4" (70 mm)	11" (279 mm)	7 1/4" (184 mm)	18 1/2" (470 mm)	12 3/4" (324 mm)	8 3/4" (222 mm)

*Available on 1 1/4" to 2" size units only **Available on 2" size units only †Refers to optional Bypass Drain Loop

Reliability, Versatility, Code Compatibility



Model 1200 REMOTE TEST®

300 PSI Bronze Ball Valve with Solenoid for Remote Operation

General Notes

1. The RemoteTEST Model 1200 is designed to provide remote functional testing of sprinkler waterflow alarm devices and confirm system viability.
2. The RemoteTEST Model 1200 is considered an auxiliary testing device and, as stipulated in NFPA 72, "the wiring does not require a supervised circuit". Installation shall be in strict conformance with the National Electrical Code (NFPA 70), NFPA 13 and 72, and/or authority having jurisdiction.

Sequence of Operation

1. Notify the central monitoring station or appropriate authority prior to testing the system.
2. The REMOTE TEST® Model 1200 is activated by a control panel supplying power to the normally closed solenoid of the REMOTE TEST®.
3. Once energized, the solenoid of the REMOTE TEST® opens which flows system water through an orifice. This moves water past the water flow alarm devices and simulates the flow to the sprinkler system. The system will then perform all the output functions associated with an alarm event, such as activating the notification appliances (horn, strobes, etc.).
4. The activation switch can then be returned to the normal position. This will de-energize the REMOTE TEST®, shut the valve, and stop the flow of system water.
5. The fire panel can then be acknowledged and reset. The system is now ready to test the next water flow alarm device.
6. The ability to manually operate each TEST AND DRAIN® valve of the REMOTE TEST® to activate each water flow alarm device is unaffected.
7. Once testing has been completed, restore the fire alarm panel and notify the appropriate authority.

Model 1200 Valve Operating Instructions

To Manual Test:



1. Turn valve handle counterclockwise from "Off" to "Test". The handle will stop automatically.
2. After test is completed return handle to "Off"

To Remote Test:

3. Activate panel controls to open the solenoid of the REMOTE TEST® to start test.
4. Release panel controls to close the solenoid of the REMOTE TEST® after test is completed.

To Drain:

1. Turn valve handle counterclockwise from "Off" to "Test". The handle will stop automatically.
2. Depress "Push" button and turn handle to "Drain".
3. When system is empty return handle clockwise to "Off" position.

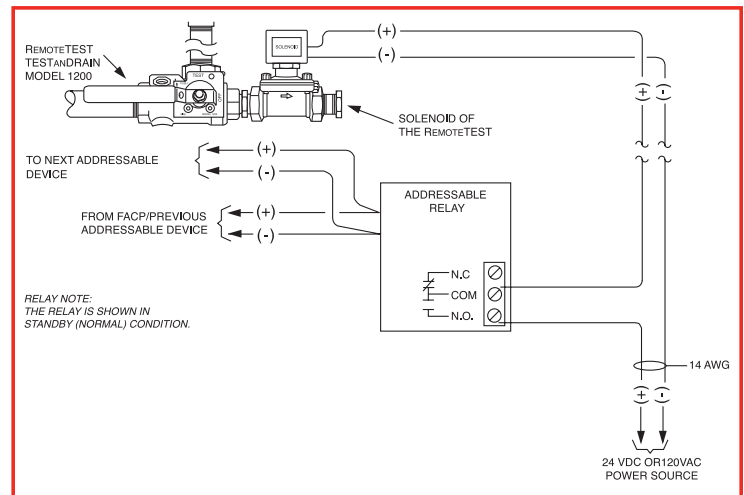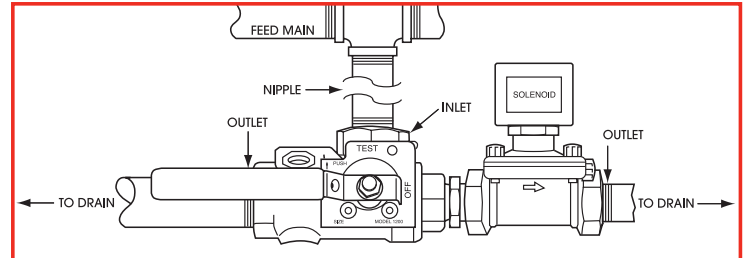

Installation Instructions for AGF Model 1200 REMOTE TEST®

1. Check the indicating plate for the correct orifice size. TEST AND DRAIN® orifices available include $\frac{3}{8}$ ", $\frac{7}{16}$ ", $\frac{1}{2}$ ", $\frac{17}{32}$ ", $\frac{5}{8}$ ", (ELO) and $\frac{3}{4}$ ", (ESFR).
2. Thread pipe nipple into the inlet of the TEST AND DRAIN®.
3. Thread pipe nipple and the TEST AND DRAIN® into the outlet of the feed main.
4. Thread piping from outlet of TEST AND DRAIN® and outlet of the solenoid of the REMOTE TEST® to an acceptable drain. Ensure coil jacket is vertical and at the top of solenoid. If needed, rotate solenoid's body.
5. Wire in accordance with applicable local and national electrical codes. Loosen the hex nut of the solenoid to rotate the coil jacket to desired position to accommodate conduit location. Using a torque wrench, tighten the hex nut to 20-25 inch pounds when installation is complete.



USA Patent # 4741361 and Other Patents Pending



AGF Manufacturing Inc.
100 Quaker Lane, Malvern, PA 19355
Phone: 610-240-4900
Fax: 610-240-4906
www.testandrain.com

Job Name: _____
Architect: _____
Engineer: _____
Contractor: _____